


PLAN VIEW

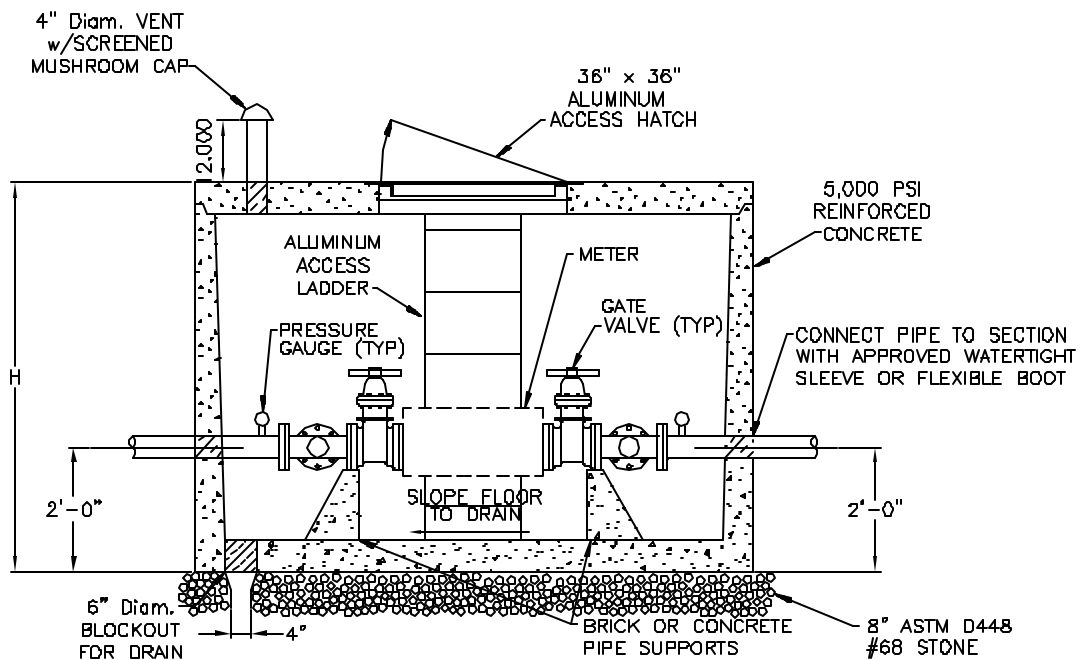

PIPE TO ATMOSPHERE—4 SCH. 40 PVC PIPE  
 OR DISCHARGE TO 2' x 2' x 2' DRY WELL  
 ASTM D448 #68 STONE  
 OR PROVIDE SUMP IN BOX AS APPROVED BY ACSA  
 NOTIFY ACSA ENGINEER IN AREAS OF HIGH WATER TABLE

SECTION VIEW

**NOTES:**

1. INVENSYS TURBO METER WITH STRAINER AND TOUCH READ SHALL BE PROVIDED BY ACSA.
2. CLEARFLOW VAULT OR APPROVED EQUAL SHALL BE SIZED TO ACCOMMODATE APPROVED METER AND MINIMUM CLEARANCES AROUND PIPING AS SHOWN.
3. METER LAYING LENGTH SHALL BE IN ACCORDANCE WITH INVENSYS CATALOG, LATEST EDITION.

**AUGUSTA COUNTY SERVICE AUTHORITY  
 VERONA, VIRGINIA**

SCALE: NONE

DRAWN BY:

DATE: FEB. 1996

REVISED: AUG. 2004

**TYPICAL METER VAULT  
 CONNECTION 3" AND LARGER**

DRAWING NUMBER: W-11

PAGE: 1 OF 1