


ALL PIPE & FITTINGS SHALL BE MECHANICALLY RESTRAINED.

PLAN

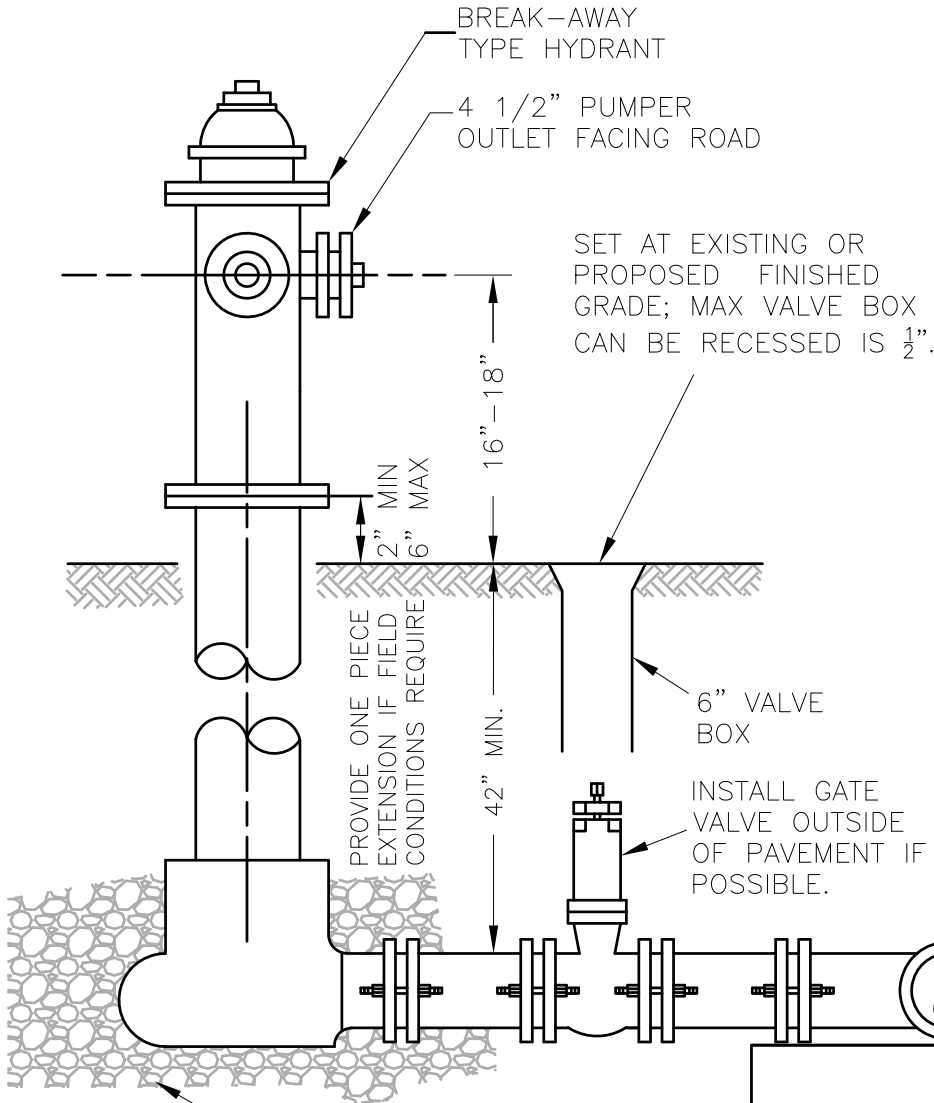

NOTES:

1. IF DRAIN HOLE WILL BE BELOW GROUND WATER LEVELS, CONTRACTOR SHALL CONSULT ACSA ON-SITE REPRESENTATIVE PRIOR TO INSTALLATION.
2. KEEP DRAIN CLEAR AND SURROUND WITH MIN. 0.5 CU. YDS. CLEAN #57 or #68 STONE FOR DRAINAGE.
3. CONTRACTOR TO APPLY PAINT IN ACCORDANCE WITH THE SPECIFICATIONS.
4. BOLLARDS MAY BE REQUIRED WHEN THE HYDRANT LOCATION IS NOT BEHIND A CURB, DITCH OR OTHER PHYSICAL BARRIER.

SEE NOTE 2.

PROFILE

**AUGUSTA COUNTY SERVICE AUTHORITY  
VERONA, VIRGINIA**

SCALE: NTS

DRAWN BY: ACSA

DATE: FEB. 1996

REVISED: OCT. 2020

**TYPICAL FIRE HYDRANT INSTALLATION**